



Karnataka Fire and Emergency Services Department

Office of the District fire officer,
Tumkur Fire station
BH Road, Tumkur - 572 103.
Ph No.0816 - 2283101.



No.135/CC/DFO/TFS/2026.

Date:23-06-2026.

To,
The Authorized Signatory
M/s. Ekalavya Model Residential School,
(Single & School Block Only)
Bajjanahalli,
Koratagere Taluk,
Tumkur District.

Sir,

Sub : Issue of "Compliance report" with respect to fire prevention, fighting and evacuation measures maintained at to M/s. Ekalavya Model Residential School, (Single & School Block Only) Bajjanahalli, Koratagere Taluk, Tumkur District.

Ref : Fire Safety Recommendation C.No.135/FSR/DFO/TFS/2026, Dt:23/06/2026

* * * * *


With reference to subject above cited, 'Fire Safety Recommendation' was issued wide reference (1) to the premises of M/s. Ekalavya Model Residential School, (Single & School Block Only) Bajjanahalli, Koratagere Taluk, Tumkur District. with a condition to fulfill the recommendations and compliance the same within 3 months.

The applicant has requested to this office for Issue of Compliance Certificate. In this regard The Fire station Officer, Koratagere is inspected the premises on 20-06-2026 for issuing Compliance Certificate. the management to M/s. Ekalavya Model Residential School, (Single & School Block Only) Bajjanahalli, Koratagere Taluk, Tumkur District. Was compiled the all recommendation communicated in Fire Safety Recommendation except training part.

Under the above circumstances the Karnataka Fire & Emergency Services Department is issuing the 'Fire Safety Compliance Certificate' to M/s. Ekalavya Model Residential School, (Single & School Block Only) Bajjanahalli, Koratagere Taluk, Tumkur District. Subject to proper maintenance of firefighting systems In good working condition. And At least 40% of employees should be trained in basic firefighting course at our R.A.Mundkur Fire and Emergency Services Training Academy, Bannerghatta Road, Bangalore-29.

This Fire Safety Compliance Certificate is Valid till 22-06-2027 and it is renewable.

Yours faithfully


District Fire Officer 23/06/26

Karnataka Fire and Emergency Services Department

Office of the District fire officer,

Tumkur Fire station

BH Road, Tumkur - 572 103.

Ph No.0816 - 2283101.



No.135/FSR/DFO/TFS/2026.

23-06-2026.

To,

The Authorized Signatory

M/s. Ekalavya Model Residential School,

(Single & School Block Only)

Bajjanahalli,

Koratagere Taluk,

Tumkur District.

Sir

Sub: Issue of Fire Safety Recommendation to M/s. Ekalavya Model Residential School, (Single & School Block Only) Bajjanahalli, Koratagere Taluk, Tumkur District.

Ref: Your letter dated:18-06-2026.

*****_****

ANNEXURE-B

NBC-2016, Part-4, Table 7 (11) 3.1.3 Group B Educational Buildings Sub division B1 & B2.

(These condition are indicative and not exclusive all relevant provisions related to fire and life safety of NBC 2016 are mandatory)

With reference to the subject cited above. The Premises of M/s. Ekalavya Model Residential School, (Single & School Block Only) Bajjanahalli, Koratagere Taluk, Tumkur District. Is inspected by Fire station Officer, Koratagere On 19-06-2026 with respect to Fire prevention, Firefighting and Evacuation measures to be complied in the premises and has submitted the details as under:

A. Details of the building / premises :-

01	Name and Address of the Applicant.	:	Authorized Signatory, <u>M/s. Ekalavya Model Residential School,</u> <u>(Single & School Block Only)</u> Bajjanahalli, Koratagere Taluk, Tumkur District.
02	Name and Address of the premises.	:	<u>M/s. Ekalavya Model Residential School,</u> <u>(Single & School Block Only)</u> Bajjanahalli, Koratagere Taluk, Tumkur District.

[Signature]

<u>M/s. Ekalavya Model Residential School, (Single & School Block Only)</u>		
03	Name and address of the Building owner	: Bajjanahalli, Koratagere Taluk, Tumkur District.
04	Number of buildings	: 01 Block.
05	Number of floors:-	: Ground floor and 01 upper floor.
<u>Floor-wise details of occupancy:-</u>		
06	Ground floor	: Class rooms-07 Office rooms-01 Wash Rooms-04 Staff Room-01, Computer lab-01
	1 st floor	: Class rooms-06, lab-05, Library-01, Wash Rooms-04 Staff Room-01,
07	Height of the buildings:-	: 07.70 Mtrs
08	Site area	: 4046 sq.Mtrs
09.	Built-up area of each floor:-	
	Ground floor	: 800 Sq. Mtrs.
	1 st floor	: 800 Sq. Mtrs.
10.	Total built-up area	: 1600 Sq. Mtrs.
<u>Surrounding properties:-</u>		
11.	West (Front)	: 4.2 meter wide road of the school
	East (Rear)	: Vacant land
	North(Side)	: Vacant Land
	South(Side)	: school Road
<u>Set-back area available around the building :-</u>		
12.	West (Front)	: 9.5Mtrs.
	East (Rear)	: 50.Mtrs.
	North(Side)	: 20.2Mtrs.
	South(Side)	: 13Mtrs.

A. On inspection of this Educational premises, the following fire prevention, firefighting and evacuation measures recommended are considered absolutely essential from fire safety point of view :-

Sl. No. (1)	Details (02)	Existing (03)	Recommendations (04)
01.	Accessibility to the premises	The site is accessible from 4.2 Mtrs Wide Road located on Western front side. It's hard enough to carry Fire Tender	Complied.
02.	No. of entrances	01 main entrance	Adequate.
03.	Width of entry / exit	01 entry of 3.9Mtrs width.	Adequate.

04.	No. of staircases available	Nos. of staircases	:	01 No.	Adequate
		Nos of Ramp	:	01 No	
		Width of Ramp	:	1.4 Mtrs	
		Width of staircases	:	1.4Mtrs	
		Width of treads	:	0.3 Mtrs	
		Height of risers	:	0.20 Mtrs	
		Nos. of riser per flight	:	25 No's	
		Height of handrails	:	01.02Mtrs	
		Head room clearance	:	03.2Mtrs	
05.	Fire extinguishers	10Nos ABC fire extinguisher of 06Kgs capacity have been provided 01No Water mist Fire extinguisher of 09Ltrs capacity have been provided Near the staircase at each floor 01No Mechanical foam Fire extinguisher of 09Ltrs capacity have been provided Near the Generator 01No Co2 Fire extinguisher of 4.5Kg capacity have been provided Near the Electrical Panel Board			Complied.
06.	No Smoking Board	COPTA Sec-4 Direction <u>No Smoking area, Smoking here is an offence</u> board should be written in English & Kannada both language have been prominently displayed at each floor			Complied.
07.	Fire siren	A fire siren has been installed in the premises to inform the inmates in the case of a fire emergency and evacuate the area.			Complied.
08.	Nominate one fire Nodal officer	The school authority has been nominated Mr. Jintendra Singh Libraian as a fire nodal officer.			Complied.
09	Escape routes	Direction in which the students have to move in the event of an emergency has been displayed in the corridor on each floor during evacuation			Complied.

10	Fire order	Fire safety indicating the details of actions to be taken in case of emergency have been displayed near each staircase landings with the telephone numbers of our Koratagere Fire Station 9481644101, 101 and telephone numbers of nearest Ambulance Service.& Police Station	Complied.
11	Firefighting training	Not Imparted	Not complied At least 40% of employees shall be trained in basic fire fighting course at our R.A.Mundkur Fire and Emergency Services Training Academy, Bannerghatta Road, Bangalore-29 at an early Date or within 03 Months.


Fire precautionary measures :-


- Explosive and flammable materials should not be stored in the store room, UPS room, Electrical panel area, class rooms, laboratory & electrical sum panel premises.
- Accumulation of combustibile waste in and around the premises should be avoided.
- The exit ways shall be always kept clear without any obstruction.
- Liquefied petroleum gas should not be stored in the building.
- The doors shall not be kept locked / latched during working hours and shall be free from obstruction.
- During the class hours the class room doors shall not be locked from inside to outside.
- As per Hon'ble supreme court order all teachers and staffs shall be trained to handle safety equipment, initiate emergency evacuation and protect their students in the event of fire and other emergency and the school shall observe the Fire Safety Day on April 14th of every year by conducting Fire Safety drills with co-ordinate with fire service department.

Under the above circumstance the Karnataka Fire & Emergency Service Department is issuing 'Fire Safety Recommendation' to M/s. Ekalavya Model Residential School, (Single & School Block Only) Bajjanahalli, Koratagere Taluk, Tumkur District. Subject to condition and compliance of the above recommendations in column-4 of serial - B within 3 months and compliance to the undersigned.


This 'Fire Safety Recommendation' is issued for a period of only one year from the date of issue

✿ All requirements recommended above are as per National Building Code- 2016 Part-4 clause 3.1.3 of Fire and Life safety will have to be complied with mandatorily.

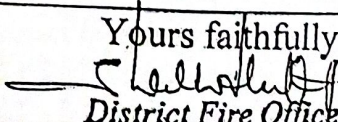
Yours faithfully,

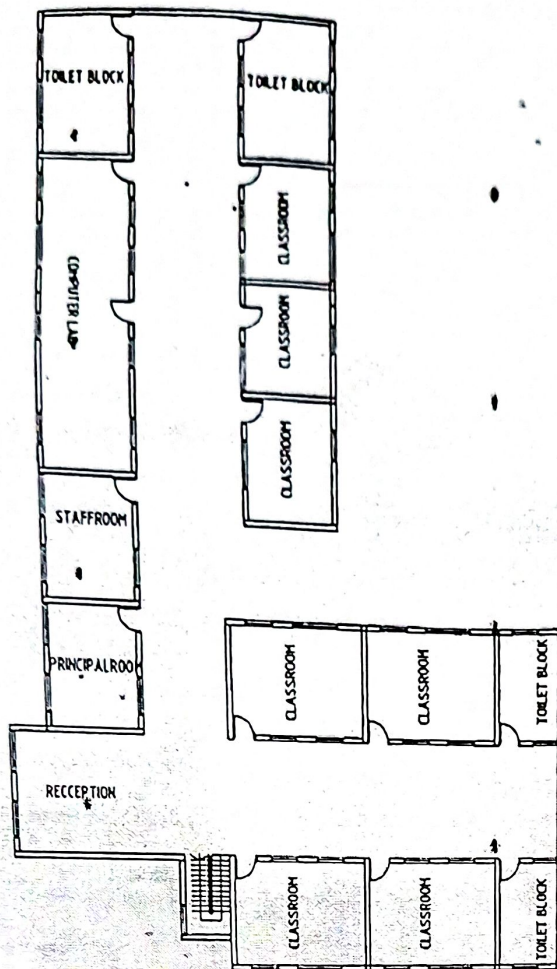 District Fire Officer
 Karnataka Fire & Emergency Services
 23/06/26

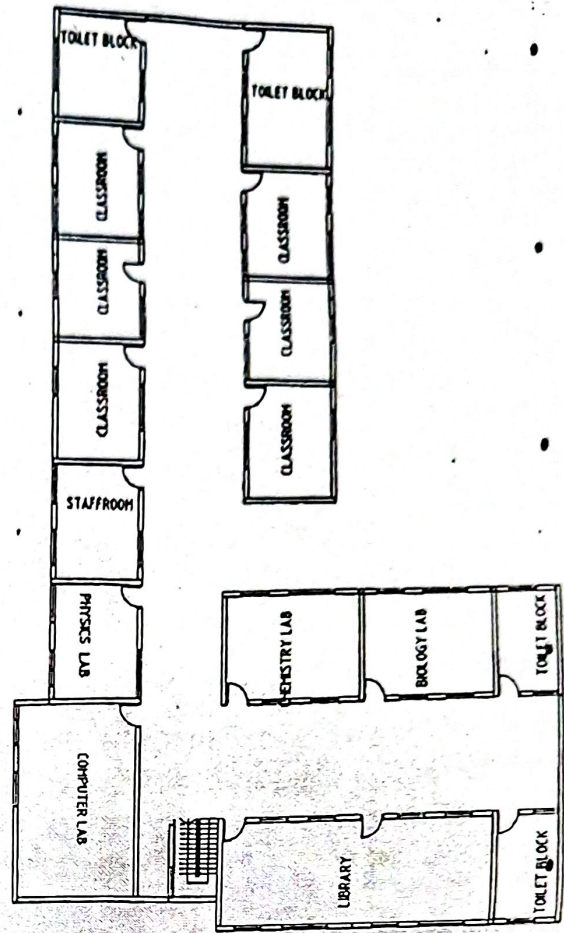

GROUND FLOOR PLAN

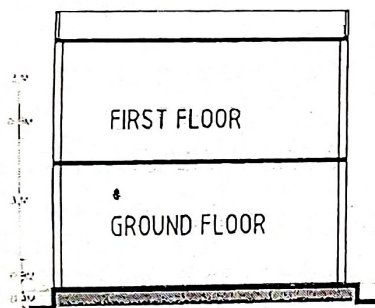

FIRST FLOOR PLAN




SECTION A-A'

PARAPET WALL
RCC ROOF


WALL
RCC ROOF

WALL
PCC ROOF

PLINTH
SSM
BASEMENT

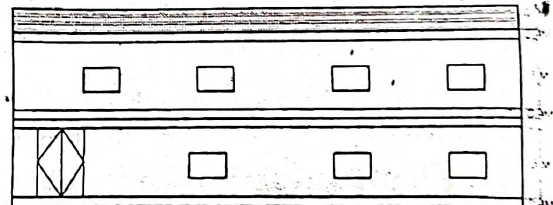

ELEVATION-1

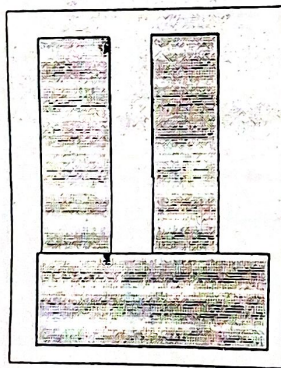

SITE PLAN

AREA STATEMENT

TOTAL SITE AREA : 4046 SQM(1 ACRE)

BUILT UP AREA GF FLOOR : 800 SQM

BUILT UP AREA 1ST FLOOR : 800 SQM

TOTAL BUILTUP AREA : 1600SQM

REMAINING AREA OF SITE : 3246 SQM

AS BUILT DRAWING

EKLAVYA MODEL RESIDENTIAL SCHOOL,
BAJJANAHALLI, KORATEGERE, TUMKUR

W.M. Design & Constructions
W.M. DESIGN & CONSTRUCTIONS
SIRA - 572 137, TUMKUR.

OPENING SCHEDULE

D1 - 1MX2.1M

W1 - 1RMX1.2M

